

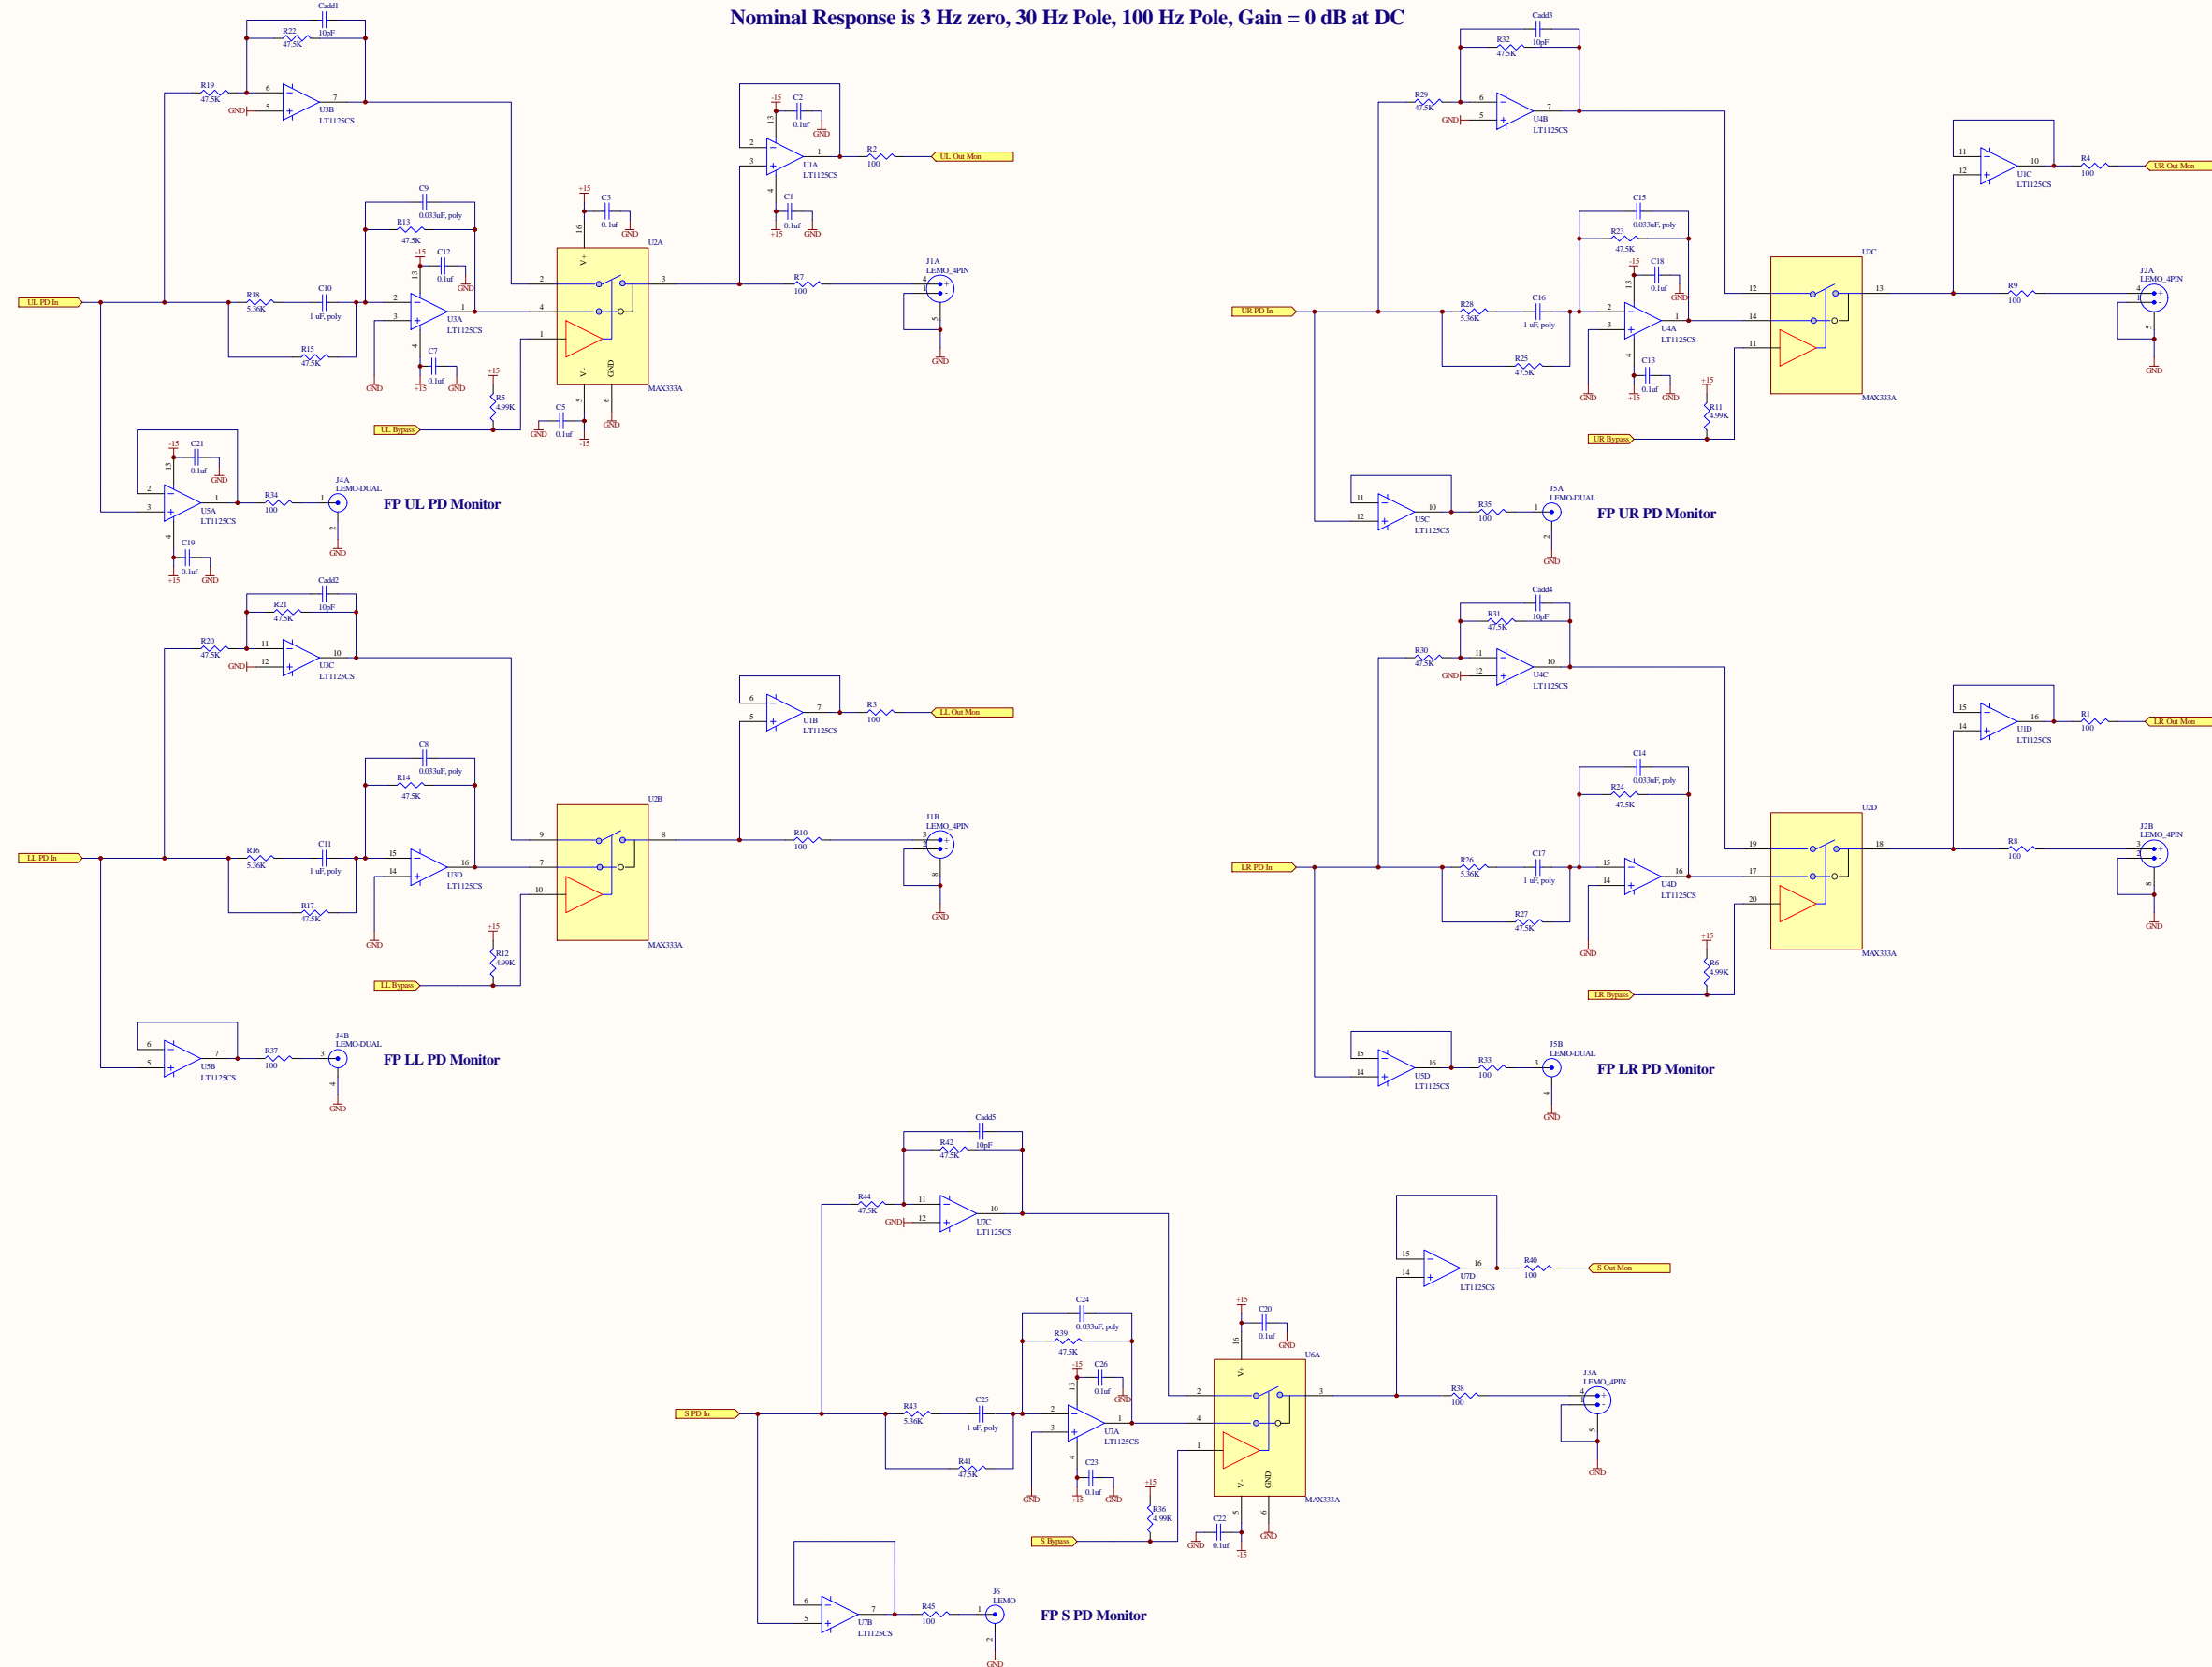
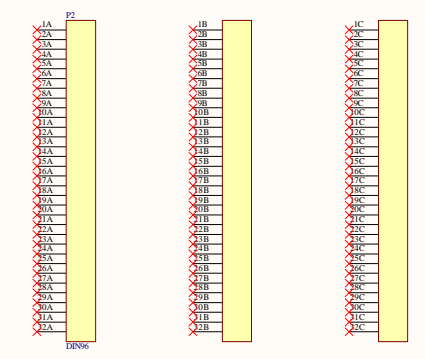


Nominal Response is 3 Hz zero, 30 Hz Pole, 100 Hz Pole, Gain = 0 dB at DC

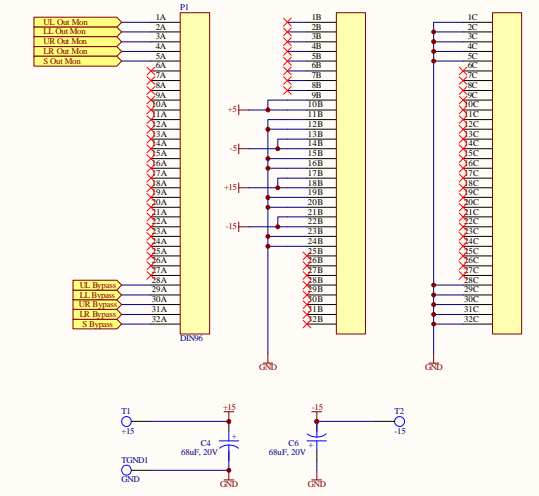

**FP PD Inputs**



Rev	Description	Date
A	Initial Release	1/01
A1	Added caps Cadd1, Cadd2, Cadd3, Cadd4, Cadd5 to cure oscillation problem on bypass stage	12/03