


MID AND END STATION "B" CHILLER YARD PLAN
 1/2" = 1'-0"

- NOTES:**
1. FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES SEE SHEET WA-H-001 AND WA-H-002.
 2. MAINTAIN 6"-8" CLEAR HEIGHT UNDER PIPES. FOR PIPE SUPPORT DETAILS SEE STRUCTURAL DRAWING WA-S-401.
 3. PROVIDE FLOOR MOUNTED FLOW SUPPORT AT THE PUMP SUCTION. CONTRACTOR MAY USE SUCTION DIFFUSER/STRAINER.
 4. REFER TO SPECIFICATIONS FOR PIPE SUPPORT REQUIREMENTS.
 5. SUPPORT PIPING TO ELIMINATE ANY LOADS TRANSMITTED FROM PIPING TO PUMPS AND CHILLERS.
 6. FOR PIPING FLOW DIAGRAM SEE SHEET WA-H-201.
 7. FOR CHILLERS AND PUMPS PIPING DETAILS SEE SHEETS WA-H-411 AND WA-H-412.
 8. FOR EXACT LOCATION OF THE CHILLERS AND PUMPS SEE CIVIL DRAWINGS.

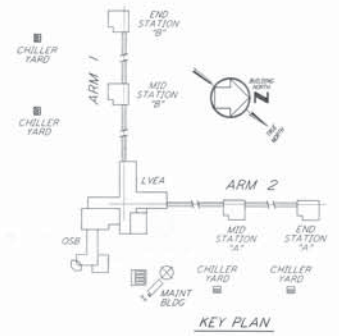

This document and the design it covers are the property of PARSONS. They are loaned only with the borrower's expressed written agreement that they will not be reproduced, copied, issued, exhibited, or used in any other way, except by written consent from PARSONS to the borrower.

REVOLUTIONS		REVOLUTIONS	
NO.	DATE	BY	CHKD

ISSUED FOR CONSTRUCTION	CEP	8-24-96
DRAWN	MMB	7/21/96
CHECKED	AA	7/31/96
ENGINEER		
PROJ		



LASER INTERFEROMETER GRAVITATIONAL-WAVE OBSERVATORY SITE NO. 1 - HANFORD, WASHINGTON

HVAC MID & END STATIONS "B" CHILLER YARD PLAN

AS NOTED PPI S0969 8094

WA-H-214

L100-0960963-00-0