


LEFT MID STATION PLAN @ EL. 100'-0"

NOTES:

1.) FOR GENERAL NOTES & LEGEND SEE PSI DWG. #V049-3-001 SHT. 1.
2.) FOR LIST OF CIVIL CONTRACTORS REFERENCE DWGS. WITH CURRENT REVISIONS SEE PSI DWG. #V049-3-001 SHT. 2.
3.) GROUND GRID IS BY OTHERS.
4.) TIE GROUNDING CONDUCTOR TO EXISTING GROUND GRID. SEE PARSONS DWG. #LA-E-212.

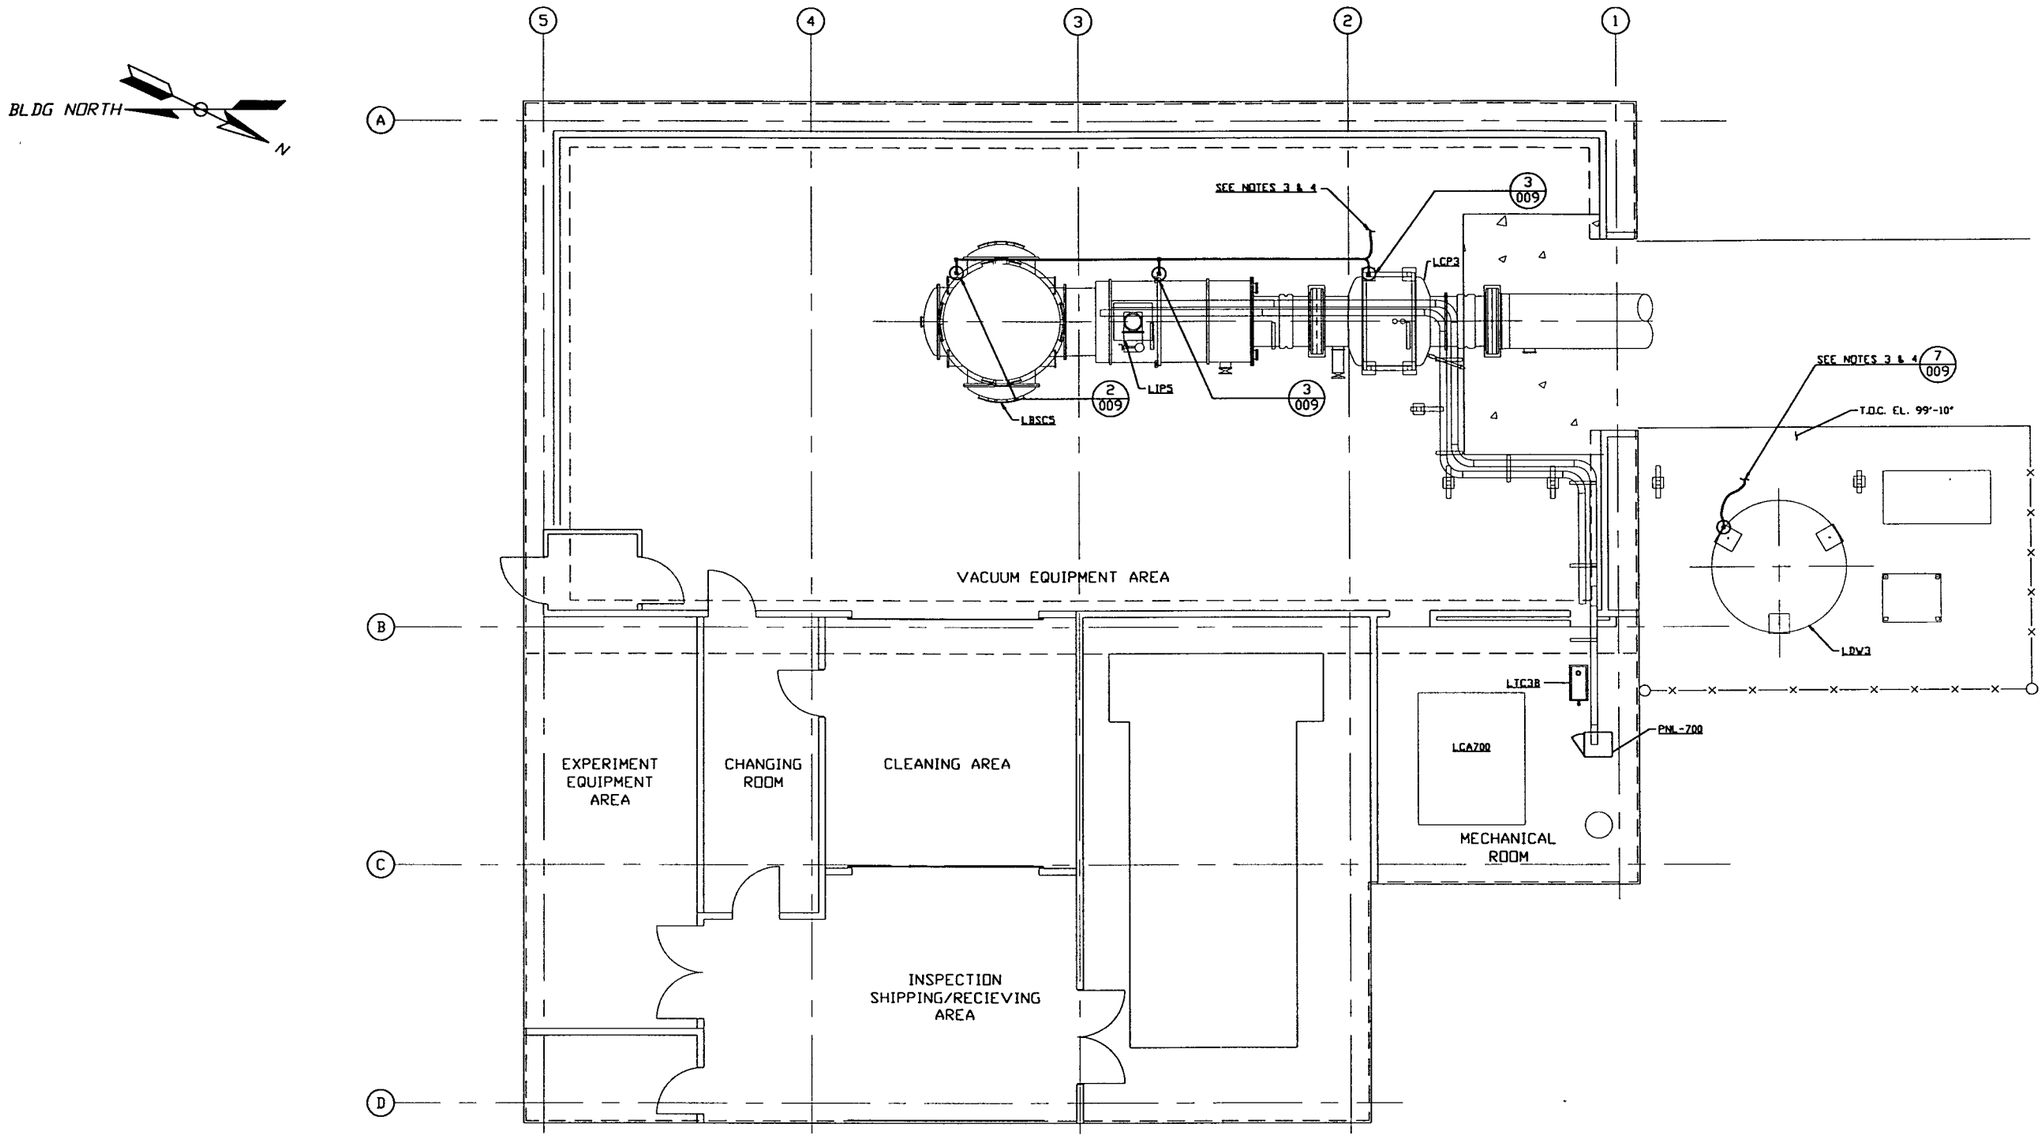


KEY PLAN

PRELIMINARY NOT FOR CONSTRUCTION

LIGO-D970144-00-V

PROPRIETARY AND CONFIDENTIAL
THE DOCUMENT CONTAINS PROPRIETARY INFORMATION BELONGING TO PROCESS SYSTEMS INTERNATIONAL, INC. OR ITS AFFILIATED COMPANIES AND SHALL BE USED ONLY FOR THE PURPOSE FOR WHICH IT WAS SUPPLIED. IT SHALL NOT BE COPIED, REPRODUCED OR OTHERWISE USED, NOR SHALL SUCH INFORMATION BE FURNISHED IN WHOLE OR IN PART TO OTHERS EXCEPT IN ACCORDANCE WITH THE TERMS OF ANY AGREEMENT UNDER WHICH IT WAS SUPPLIED OR WITH THE PRIOR WRITTEN CONSENT OF PROCESS SYSTEMS INTERNATIONAL, INC. AND SHALL BE RETURNED UPON REQUEST.

REFERENCE DRAWINGS

| DWG. NO. | DESCRIPTION |
|---|---|
| V049-3-702 | CABLE TRAY PLAN LOUISIANA LEFT END STATION |
| V049-3-009 | GROUNDING DETAILS |
| V049-3-003 | OVERALL SITE PLAN LOUISIANA |
| V049-3-001 | GENERAL NOTES & LEGEND |

| DWG. NO. | DESCRIPTION |
|---|---|
| | |
| | |

UNLESS OTHERWISE SPECIFIED
DIMENSIONS ARE IN INCHES
TOLERANCES:
FRACTIONAL ±
ANGULAR:MACH 30°-39' BEND ±2°
TWO PLACE DECIMAL ± .01
THREE PLACE DECIMAL ± .005
FINISHED SURFACE RMS
BREAK CORNERS .06 OUT.
REMOVE ALL BURRS

DO NOT SCALE THIS DRAWING
USED ON
NEXT ASS'Y

| REV | DESCRIPTION | CHKD | DRVN | DATE | DEC# |
|---|---|---|---|---|---|
| 0 | ISSUE FOR LA DESIGN REVIEW | REB | DWL | 02.24.97 | 0430 |

ISSUE DESCRIPTION

PROCESS SYSTEMS INTERNATIONAL INC.
20 WALKUP DR. WESTBOROUGH, MASSACHUSETTS 01581 USA

GROUNDING PLAN
LIGO VACUUM EQUIPMENT
LOUISIANA SITE
LEFT END STATION

| CAD FILE | SIZE | DWG. NO. | REV. |
|---|---|---|---|
| V0493709 | D | V049-3-709 | 0 |

SCALE 3/16" = 1'-0" SHEET 1 OF 1